


Customer:
• Sales Order Number:
• Number of Air Handlers:
PC Network Information:
• IP Address:
• Subnet Mask:
• Gateway:
Router Network Information:
• IP Address:
• Subnet Mask:
• Gateway:

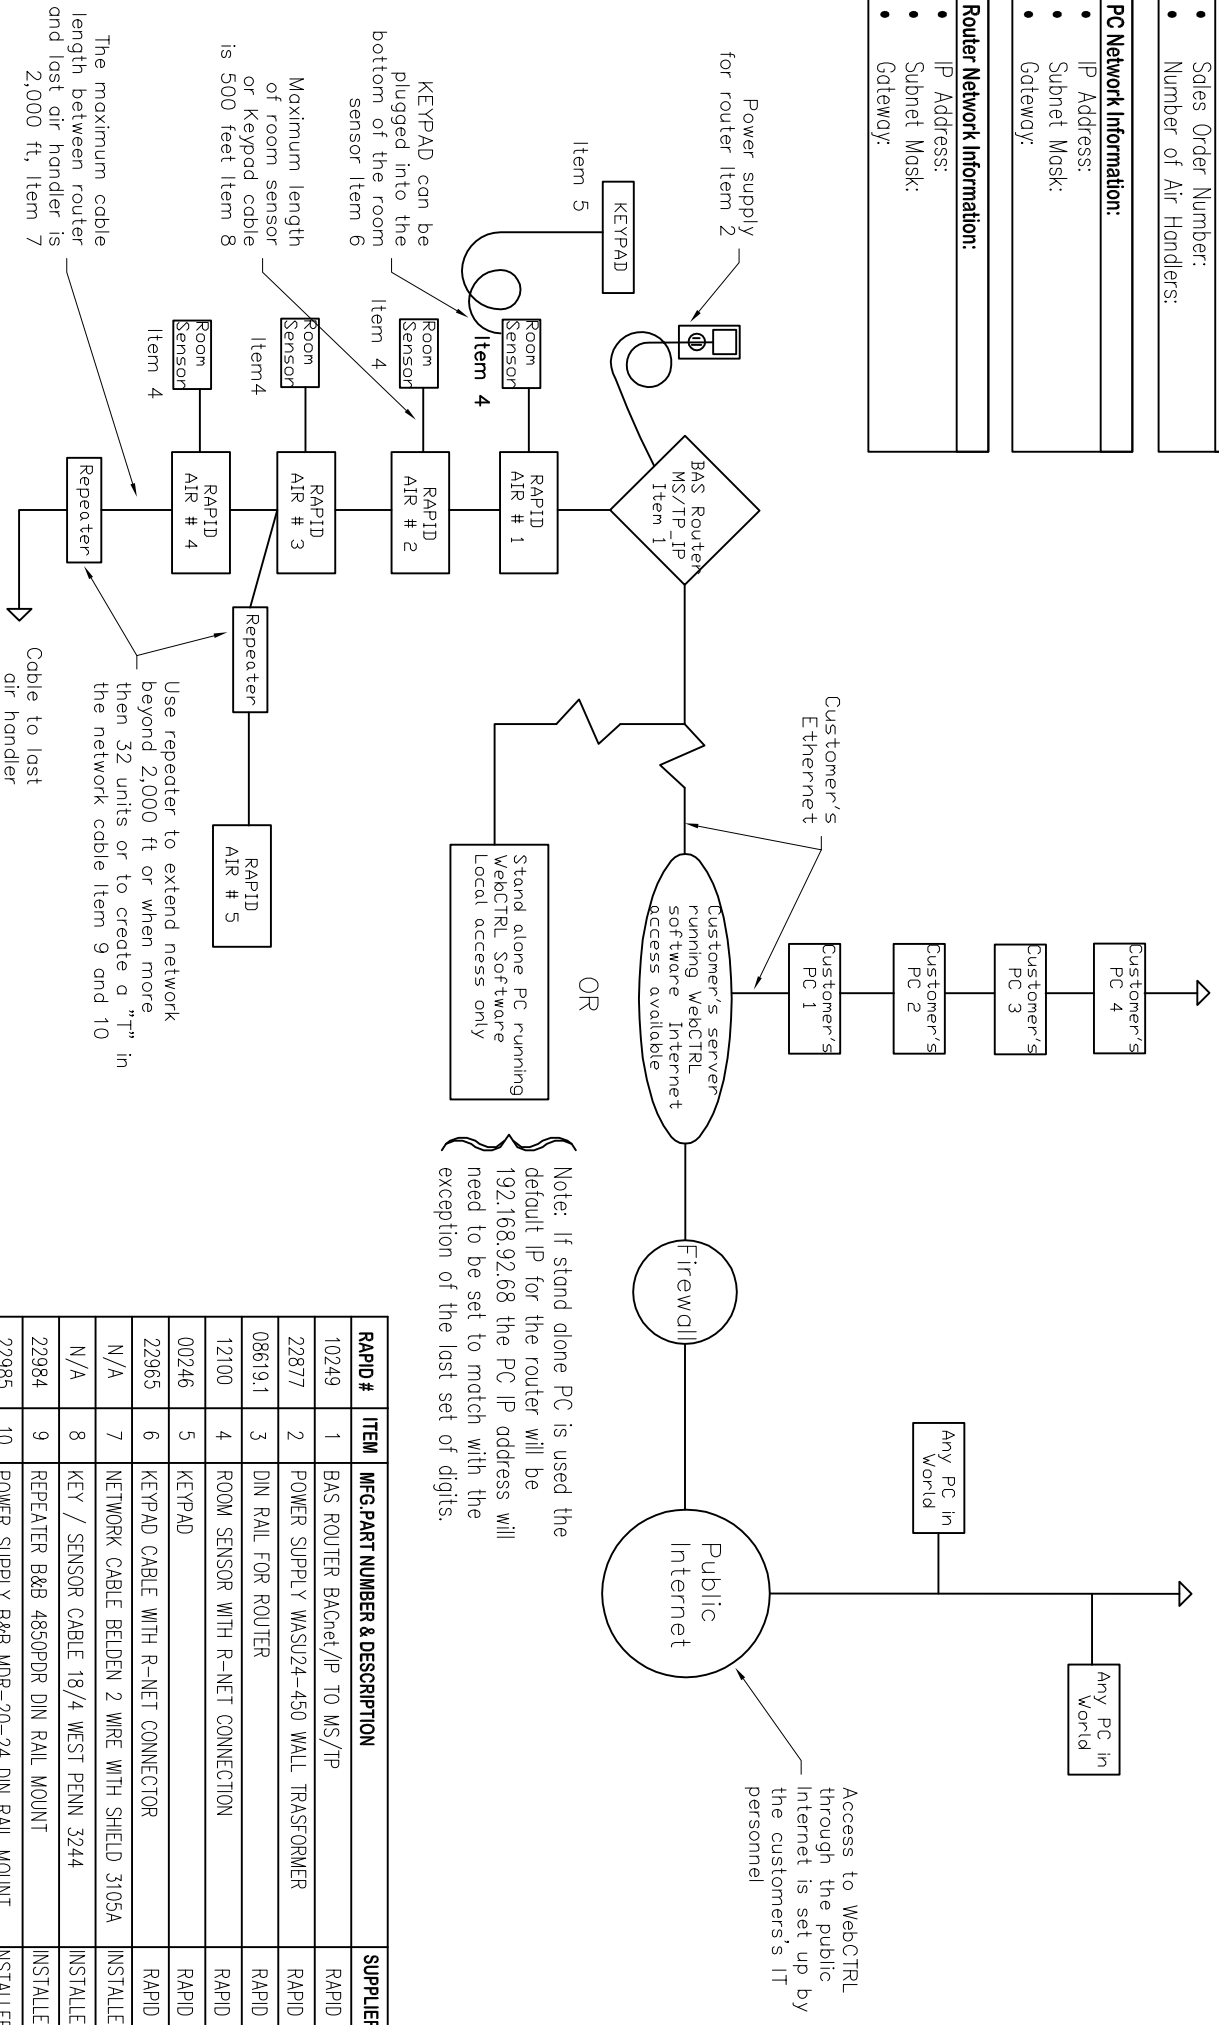

RAPID #	ITEM	MFG. PART NUMBER & DESCRIPTION	SUPPLIER
10249	1	BAS ROUTER BACnet/IP TO MS-/TP	RAPID
22877	2	POWER SUPPLY WASU24-450 WALL TRANSFORMER	RAPID
08619.1	3	DIN RAIL FOR ROUTER	RAPID
12100	4	ROOM SENSOR WITH R-NET CONNECTION	RAPID
00246	5	KEYPAD	RAPID
22965	6	KEYPAD CABLE WITH R-NET CONNECTOR	RAPID
N/A	7	NETWORK CABLE BELDEN 2 WIRE WITH SHIELD 3105A	INSTALLETE
N/A	8	KEY / SENSOR CABLE 18/4 WEST PENN 32+4	INSTALLETE
22984	9	REPEATER B&B 4850PDR DIN RAIL MOUNT	INSTALLETE
22985	10	POWER SUPPLY B&B MDR-20-24 DIN RAIL MOUNT	INSTALLETE

THIS SHEET IS FOR GENERAL INFORMATION PURPOSES ONLY. INFORMATION CAN CHANGE WITHOUT NOTICE AND SHOULD THEREFORE NOT BE USED FOR CONSTRUCTION OR INSTALLATION. ALL PRODUCTS MUST BE SET-UP, ASSEMBLED, INSTALLED AND USED IN ACCORDANCE WITH ALL APPLICABLE INSTRUCTIONS, THE PROVIDED INSTRUCTION MANUAL AS WELL AS REQUIREMENTS OF GOVERNMENT AUTHORITIES. THE INFORMATION ON THIS SHEET IS PROPRIETARY AND IS THE PROPERTY OF RAPID ENGINEERING LLC. ©RAPID ENGINEERING LLC

THIS SHEET IS FOR GENERAL INFORMATION PURPOSES ONLY. INFORMATION CAN CHANGE WITHOUT NOTICE AND SHOULD THEREFORE NOT BE USED FOR CONSTRUCTION OR INSTALLATION. ALL PRODUCTS MUST BE SET-UP, ASSEMBLED, INSTALLED AND USED IN ACCORDANCE WITH ALL APPLICABLE INSTRUCTIONS, THE PROVIDED INSTRUCTION MANUAL, AS WELL AS REQUIREMENTS OF GOVERNMENTAL AUTHORITIES. THE INFORMATION ON THIS SHEET IS PROPRIETARY AND IS THE PROPERTY OF RAPID ENGINEERING LLC. ©RAPID ENGINEERING, LLC					
Job:	—	REV.	Eco#	DATE	CK BY
Date:	—	Tag#:	—	—	—
			—	—	—
			—	—	—
FILE LOCATION:	HTR-SUB	SCALE 12" = 1'	DRAWN BY:	KI	DATE: 1-21-14
PLOT RATIO: 1:1	CK BY:	WO#	—	REV.	DWG NO.
			A 40436813	—	—